


1. A SERVICE LINE MAY BE USED FOR RESIDENTIAL DOMESTIC AND FIRE PROTECTION NEEDS SIMULTANEOUSLY WITH PWD APPROVAL, PROVIDED THE SPRINKLER SYSTEM IS ISOLATED FROM THE DOMESTIC SUPPLY AS SHOWN.
2. THE SPLIT FOR THE SPRINKLER SERVICE MUST BE LOCATED AFTER THE WATER METER. WET SPRINKLER SYSTEMS MUST ALSO INCLUDE A NON-TESTABLE DUAL CHECK BACKFLOW PREVENTER AS SHOWN.
3. METER SIZE SHALL BE SPECIFIED BY THE SPRINKLER SYSTEM DESIGNER TO ACCOMMODATE NECESSARY FLOWS FOR FIRE PROTECTION. PWD MUST RECEIVE DOCUMENTATION FROM THE DESIGNER OF REQUIRED METER SIZING PRIOR TO ACTIVATION.
4. IF A METER UPGRADE IS REQUIRED, CUSTOMER SHALL PAY ANY NECESSARY UPGRADE FEES PRIOR TO SCHEDULING METER SET.

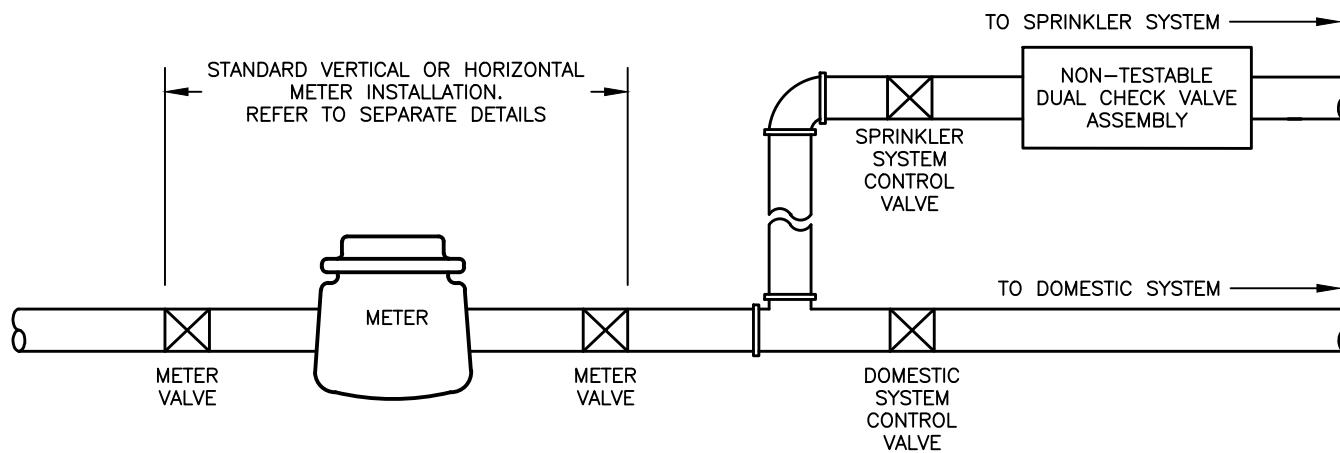

Portland Water District

ASSET MANAGEMENT & PLANNING DEPARTMENT
 225 DOUGLASS ST, PORTLAND ME 04104-3553 (207)
 207-774-5961 • 207-7761-8307 (FAX) • WWW.PWD.ORG

DATE	REVISION	SCALE: NTS	RESIDENTIAL SPRINKLER SYSTEM PIPING (UP TO 2")	
		DATE: 06/15/14	STANDARD METER SET DETAILS	
		DRAWN BY: TAW		
		CHECKED BY: JRS	PROJECT NO: NA	SHEET: 1 OF 1
		APPROVED BY: GSJ		
		FILE: WS05.DWG		