


NOTES

1. PORTLAND WATER DISTRICT (PWD) WILL SUPPLY THE WATER METER. ALL OTHER MATERIALS, INCLUDING VALVES AND METER RESETTER, TO BE SUPPLIED AND INSTALLED BY THE CUSTOMER.
2. THE METER WILL BE INSTALLED BY PWD PERSONNEL. ONLY PWD PERSONNEL SHALL OPERATE SERVICE VALVES.
3. THE SIZE OF THE METER RESETTER SHOULD MATCH THE SIZE OF THE METER TO BE INSTALLED. IF THE RESETTER IS A DIFFERENT SIZE, CUSTOMER WILL INSTALL ALL NECESSARY ADDITIONAL FITTINGS.
4. THE METER MUST BE LOCATED DIRECTLY AFTER THE SERVICE PIPE ENTERS THE BUILDING. AT THE METER SET LOCATION CUSTOMER WILL INSTALL A METER RESETTER AND TWO METER VALVES AS SHOWN, WITH 6" MINIMUM CLEARANCE BETWEEN THE SERVICE PIPE AND ANY WALL OR FLOOR.
5. THE METER SHALL NOT BE PERMANENTLY ENCLOSED WITHOUT SUFFICIENT ACCESS FOR FUTURE SERVICE. THERE SHALL BE A MINIMUM OF 36" OF WORKING SPACE TO ENABLE SERVICING OF THE METER.
6. ACCEPTABLE MANUFACTURERS OF METER RESETTERS INCLUDE: MUELLER, FORD OR MCDONALD, UNLESS OTHERWISE AGREED TO BY PWD.
7. BACKFLOW PREVENTION MAY BE REQUIRED BY PWD DEPENDING ON TYPE OF SERVICE AND DEGREE OF CROSS-CONNECTION HAZARD. IF REQUIRED, AN APPROPRIATE DEVICE SHALL BE INSTALLED DOWNSTREAM OF METER AND METER VALVES PRIOR TO METER SET.

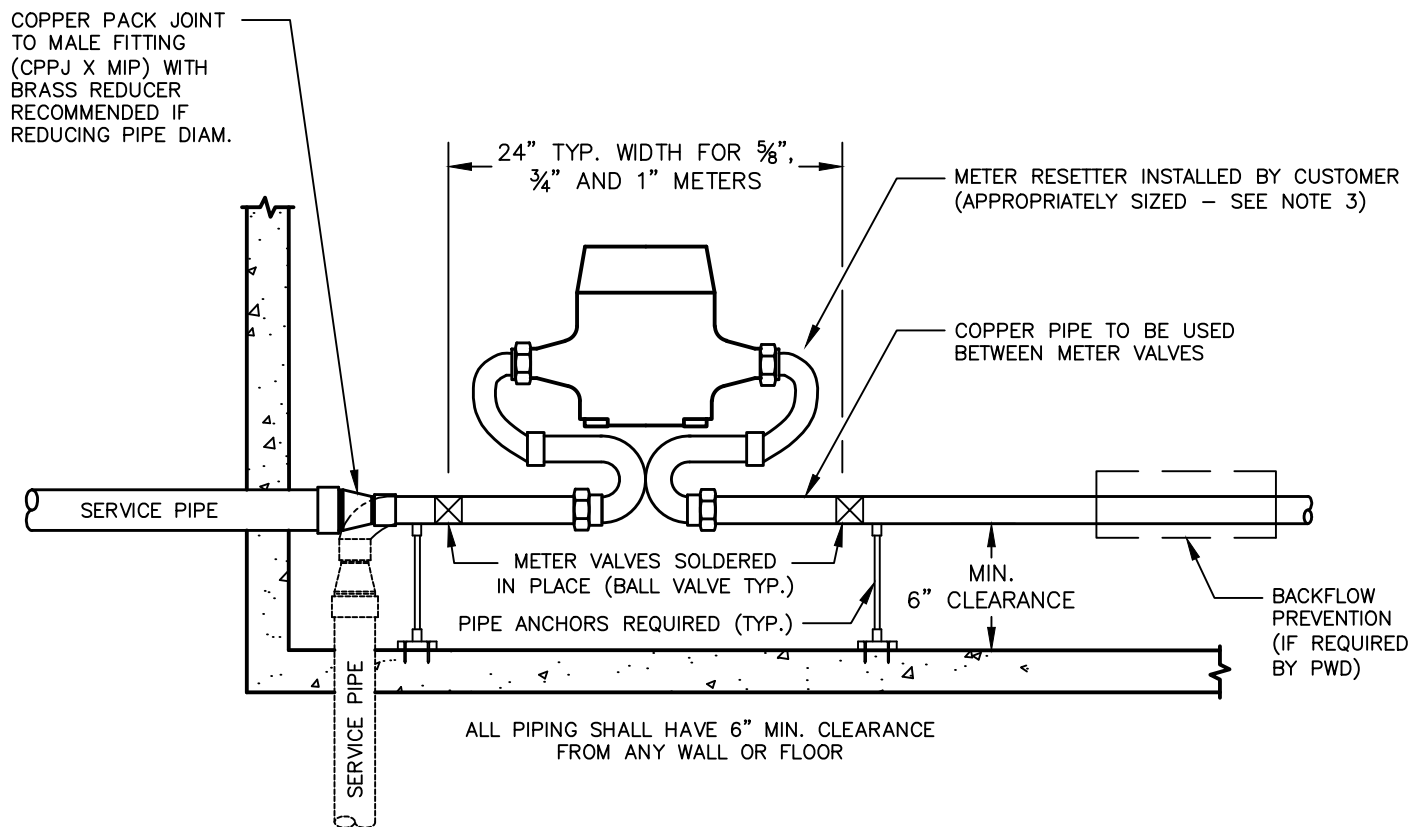

**Portland Water District**  
 ASSET MANAGEMENT & PLANNING DEPARTMENT  
 225 DOUGLASS ST, PORTLAND ME 04104-3553 (207)  
 207-774-5961 • 207-7761-8307 (FAX) • WWW.PWD.ORG

DATE	REVISION	SCALE:	NTS
09/24/14	METER RESETTER SIZING	DATE:	06/15/14
06/22/15	PIPE MATERIAL	DRAWN BY:	TAW
		CHECKED BY:	JRS
		APPROVED BY:	GSJ
		FILE:	WS01.DWG

HORIZONTAL METER INSTALLATION  
 (5/8" TO 1")

STANDARD METER SET DETAILS

PROJECT NO: NA

SHEET: 1 OF 1